
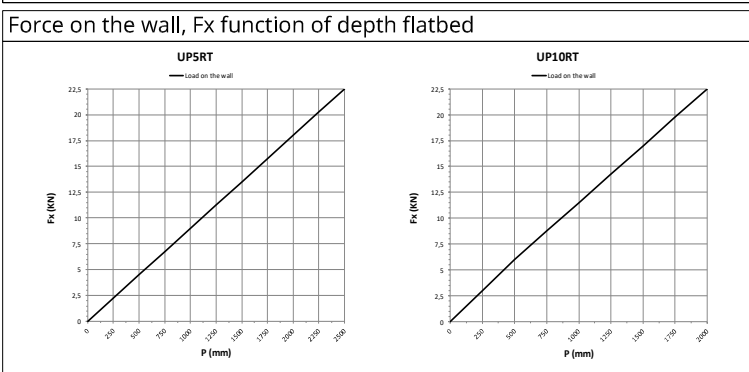


Motor	Tension-functioning	Starter	Suggested switch*	Rated current	Current starter
3kW	220 V - 3ph	Direct	3x16A id=0,3A	10	35
	380 V - 3ph	Direct	4x16A id=0,3A	5	22
4kW	220 V - 3ph	Direct	3x20A id=0,3A	16	50
	380 V - 3ph	Direct	4x16A id=0,3A	8	25
5,5kW	220 V - 3ph	Direct	4x25A id=0,3A	22	60
	380 V - 3ph	Direct	4x16A id=0,3A	11	35

MODEL: UP5RT - 500Kg UP10RT - 1000Kg

Date: _____ Signature for approval: _____





MISURE IN mm

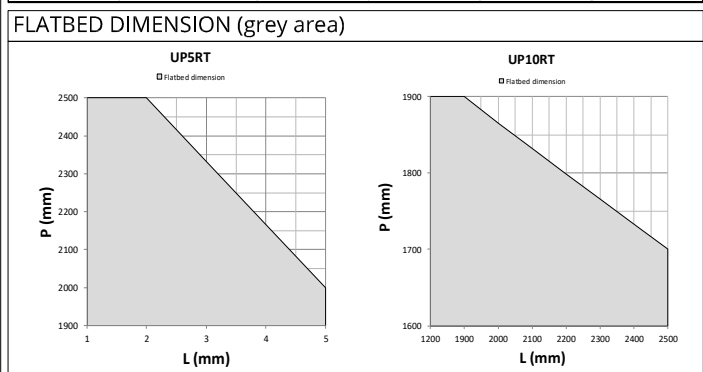


UPDINAMIC Via Modigliani, 22 - 37045 Legnago (VR) - Tel.0442.59.01.29 - Fax. 0442.59.90.91
www.updinaric.com - e-mail: info@updinaric.com

Q.TA DESCRIZIONE: MODEL: UP5-10RT STROKE MAX: 12000mm ONLY FOR GOODS

Cliente: _____ Data: 09/09/19
Disegno n°: TAV-UP5-10RT-STD01
Sostituto dot. _____
Sostitutrice it. _____

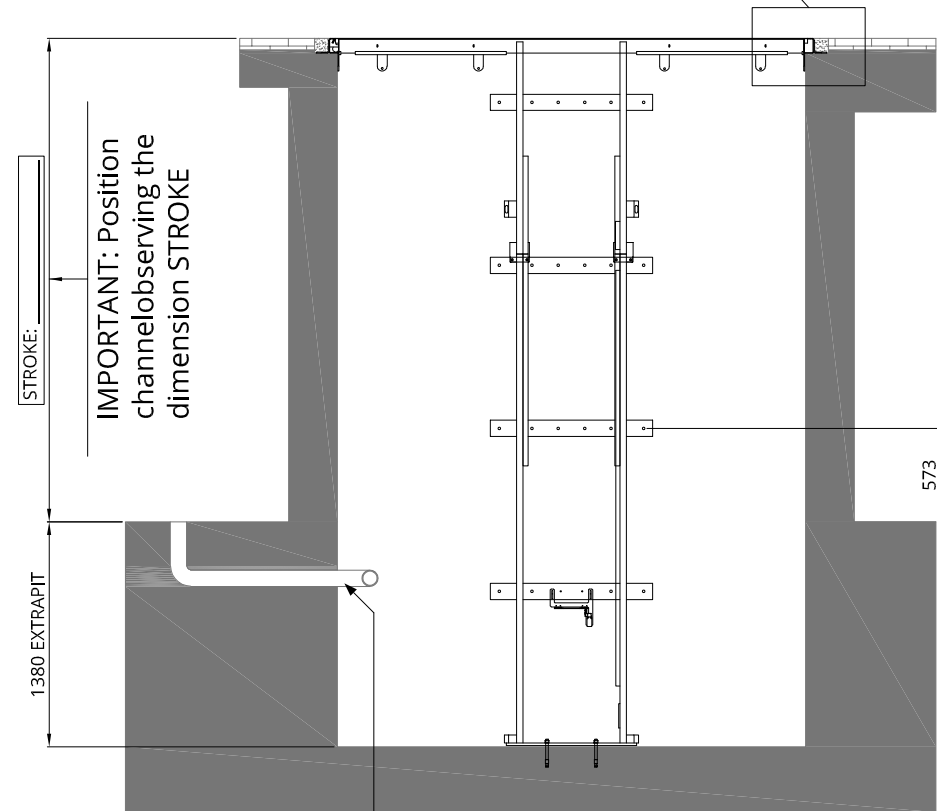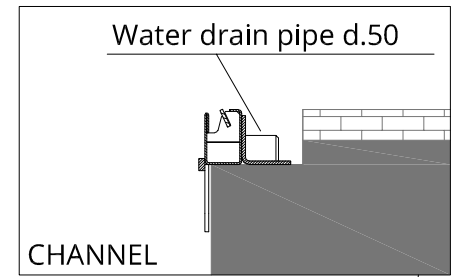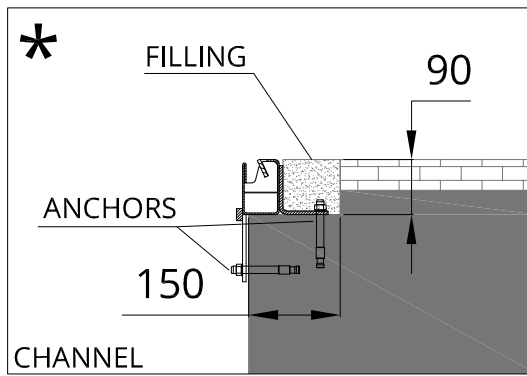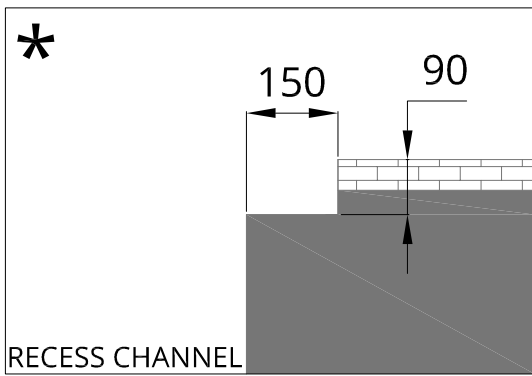


IMPORTANT: Position guides observing the dimension indicated by the channel and check 573 from the downstairs level

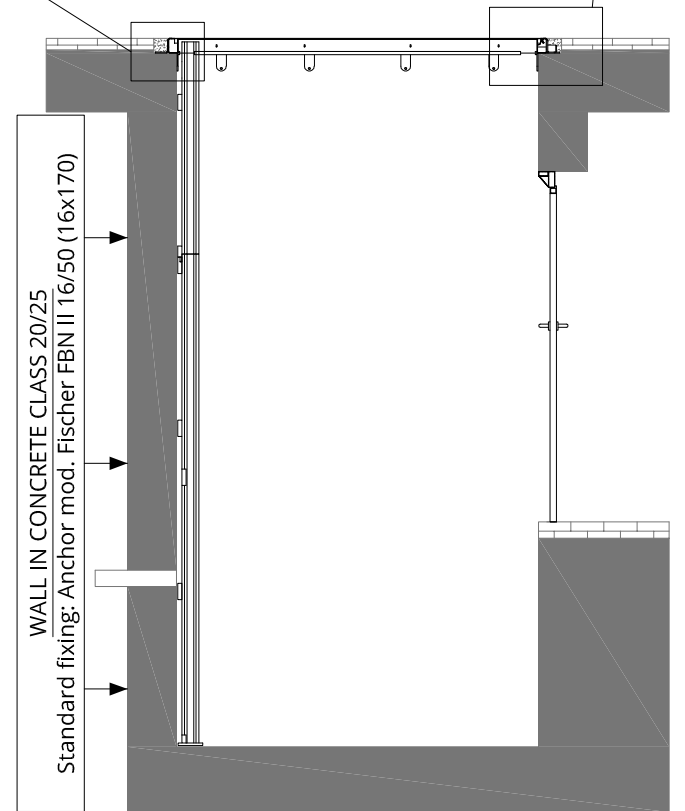


PREPARE CORRUGATED TUBE Ø10cm TO THE TECHNICAL AREA

Water drain pipe d.50

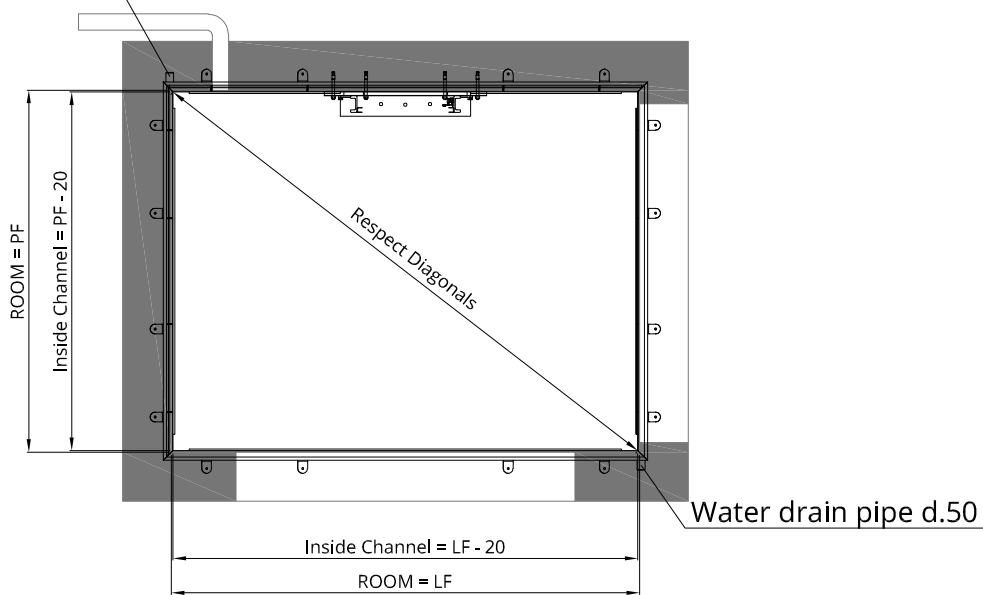

MARK THE ENTRANCES AND THE HEIGHT OF FLOOR

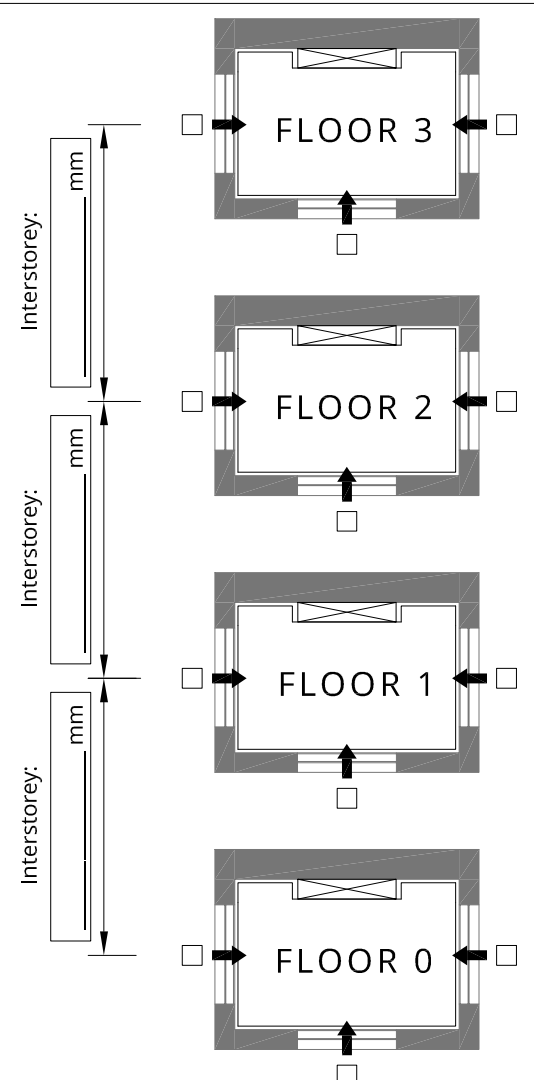

Motor	Tension-functioning	Starter	Suggested switch*	Rated current	Current starter
3kW	220 V - 3ph	Direct	3x16A id=0,3A	10	35
	380 V - 3ph	Direct	4x16A id=0,3A	5	22
4kW	220 V - 3ph	Direct	3x20A id=0,3A	16	50
	380 V - 3ph	Direct	4x16A id=0,3A	8	25
5,5kW	220 V - 3ph	Direct	4x25A id=0,3A	22	60
	380 V - 3ph	Direct	4x16A id=0,3A	11	35


MODEL: UP5RT - 500Kg UP10RT - 1000Kg

Date: _____ Signature for approval: _____




MISURE IN mm

FLATBED DIMENSION (grey area)

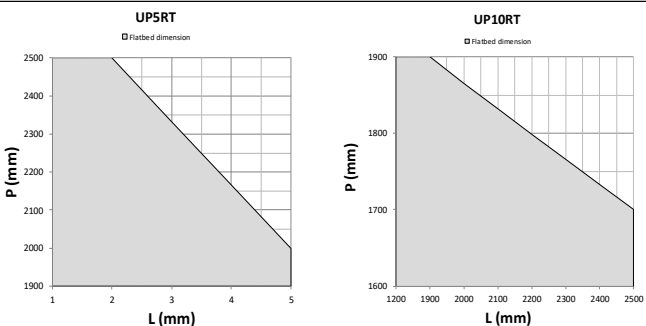

Force on the wall, Fx function of depth flatbed

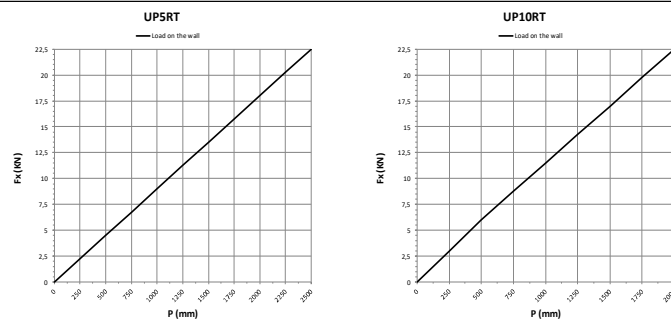

UPDINAMIC Via Modigliani, 22 - 37045 Legnago (VR) - Tel.0442.59.01.29 - Fax. 0442.59.90.91
www.updynamic.com - e-mail: info@updynamic.com

Q.TA	DESCRIZIONE:	Cliente:
	MODEL: UP5-10RT SPB	Updynamic
	STROKE MAX: 12000mm	Data: 09/09/19
	PIT DETAILS	Disegno n°:
		TAV-UP5-10RT-PIT
		Sostituto dat.:
		Sostitutore it.: